


# City of North Pole Source Raw Well Water Results

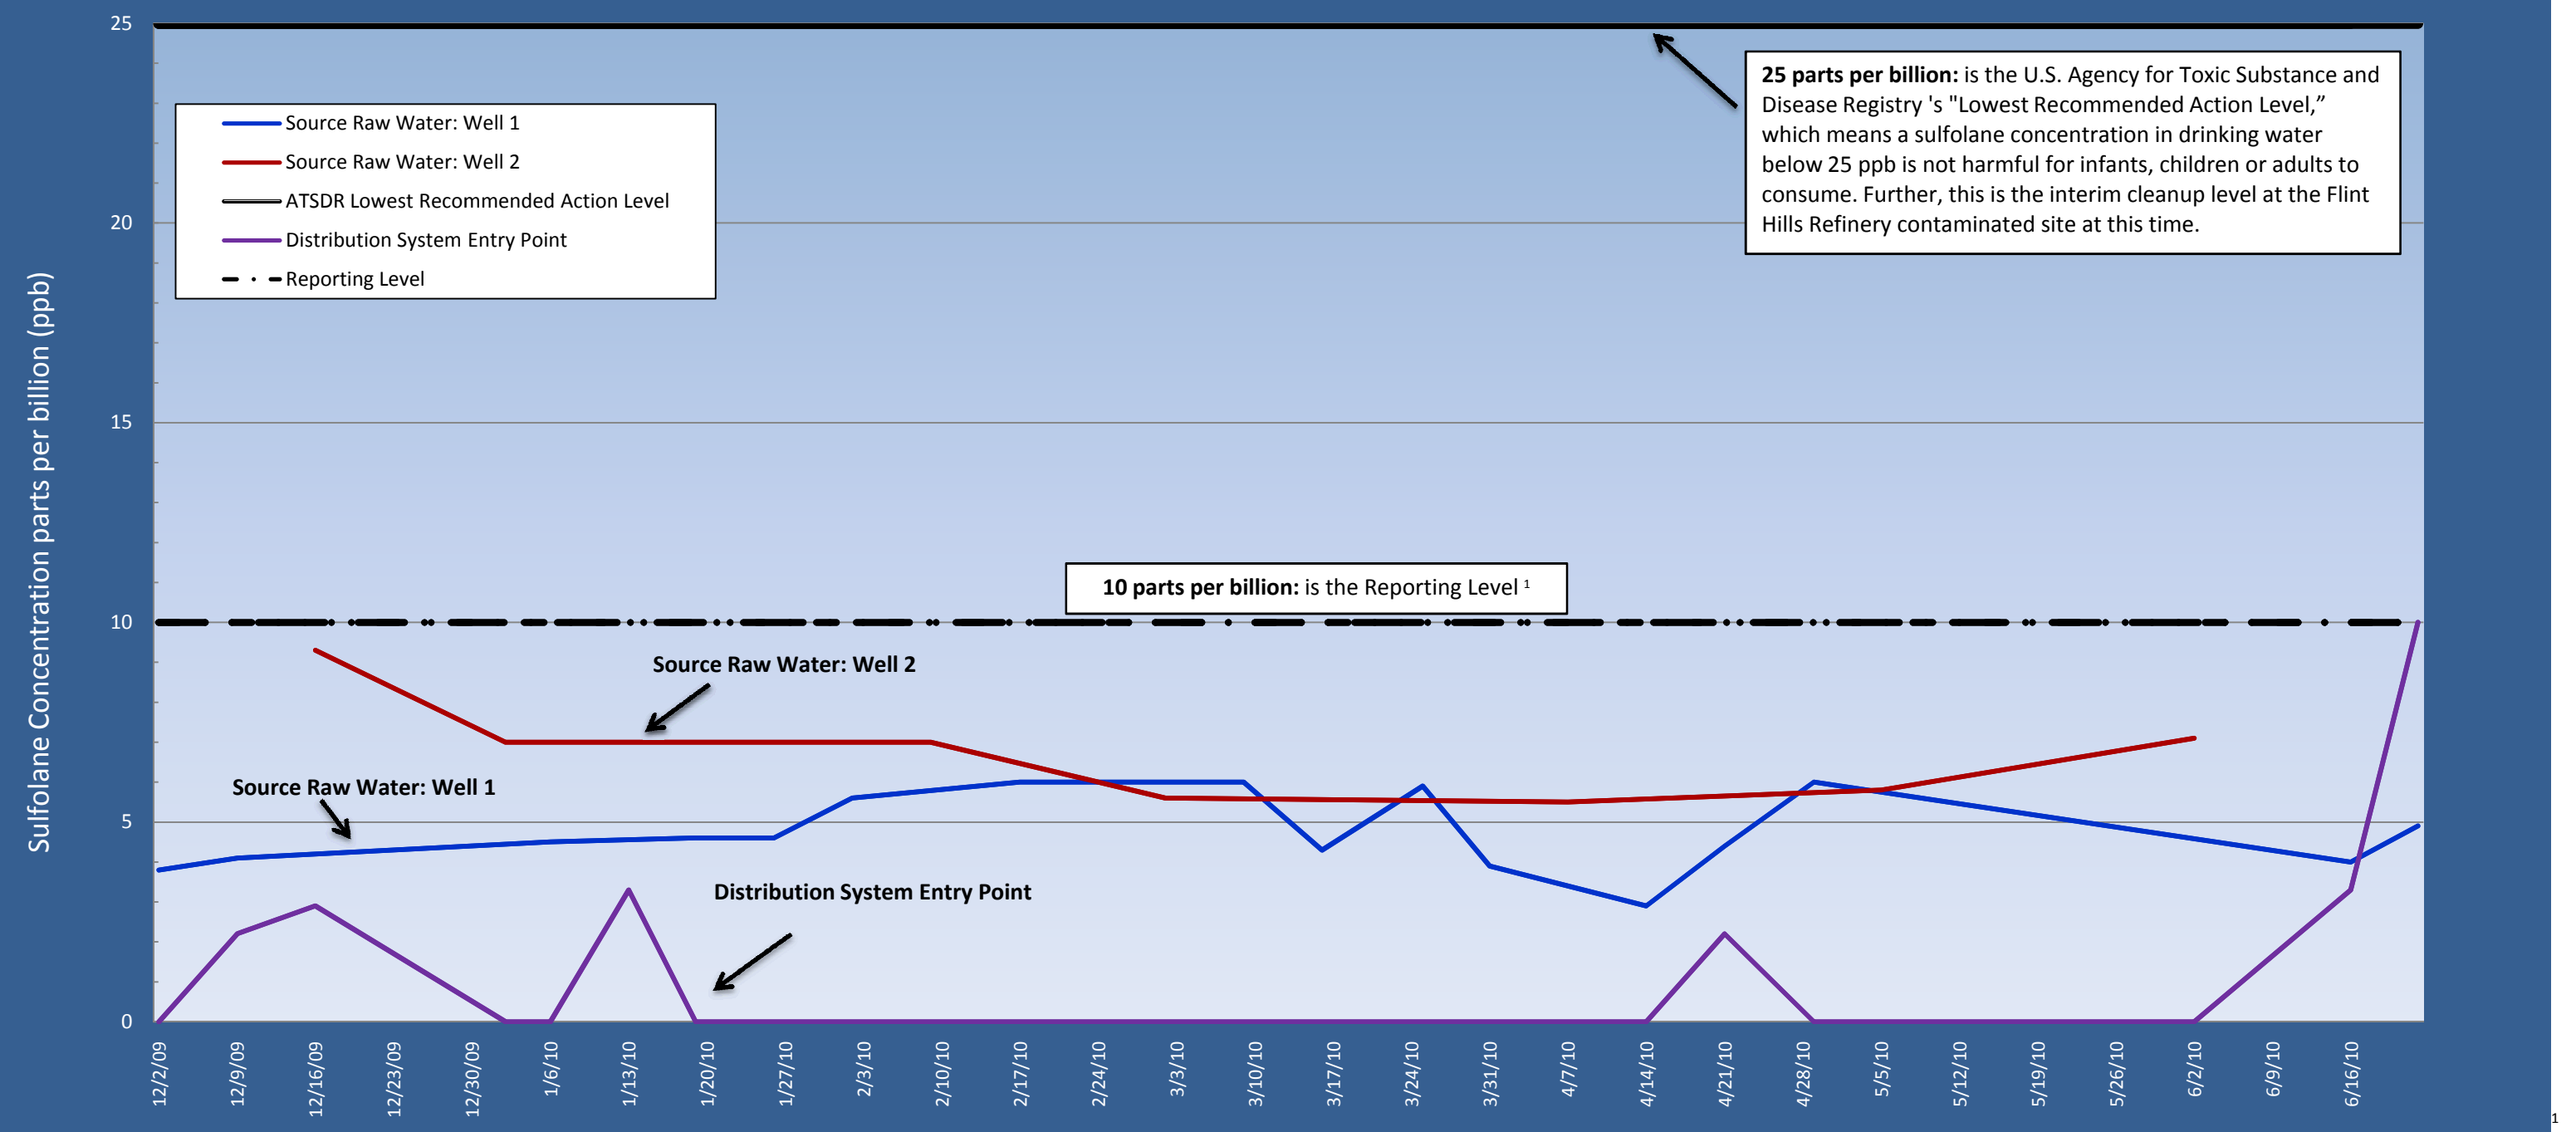

	12/2/09	12/9/09	12/16/09	1/2/10	1/6/10	1/13/10	1/19/10	1/26/10	2/2/10	2/9/10	2/17/10	3/2/10	3/9/10	3/16/10	3/25/10	3/31/10	4/7/10	4/14/10	4/21/10	4/29/10	5/5/10	6/2/10	6/16/10	6/22/10	8/4/10	8/18/10	9/2/10
—Source Raw Water: Well 1	3.8	4.1			4.5		4.6	4.6	5.6		6		6	4.3	5.9	3.9		2.9	4.4	6			4	4.9	ND	ND	ND
—Source Raw Water: Well 2			9.3	7		7				7		5.6					5.5				5.8	7.1					
—Distribution System Entry Point	0	2.2	2.9	0	0	3.3	0	0	0	0	0	0	0	0	0	0	0	0	2.2	0	0	0	3.3	10	ND	ND	ND

<sup>1</sup> The lowest concentration of the substance tested that can be reported reliably in the sample under normal laboratory conditions